


DESIGN REQUIREMENTS FOR TOP LIFT DEPTH

	RESIDENTIAL DRIVEWAY OR PEDESTRIAN ONLY	PRIVATE STREET, PARKING LOT, OR FIRE LANE	PUBLIC STREET
CONCRETE	4"	4"	7"
ASPHALT	2 1/2"	3"	6"
PAVERS	2 3/8"	3 1/8"	3 1/8"
ENGINEERING REQ'D	NO	YES	YES
COMPACTION REQ'D	NO	YES	95%

PERMEABLE CONCRETE BLOCK OR "PAVER" SYSTEMS

NOTE: 6" UNDERDRAIN REQUIRED FOR TYPE C AND TYPE D SOILS (<2"/HR INFILTRATION RATES)

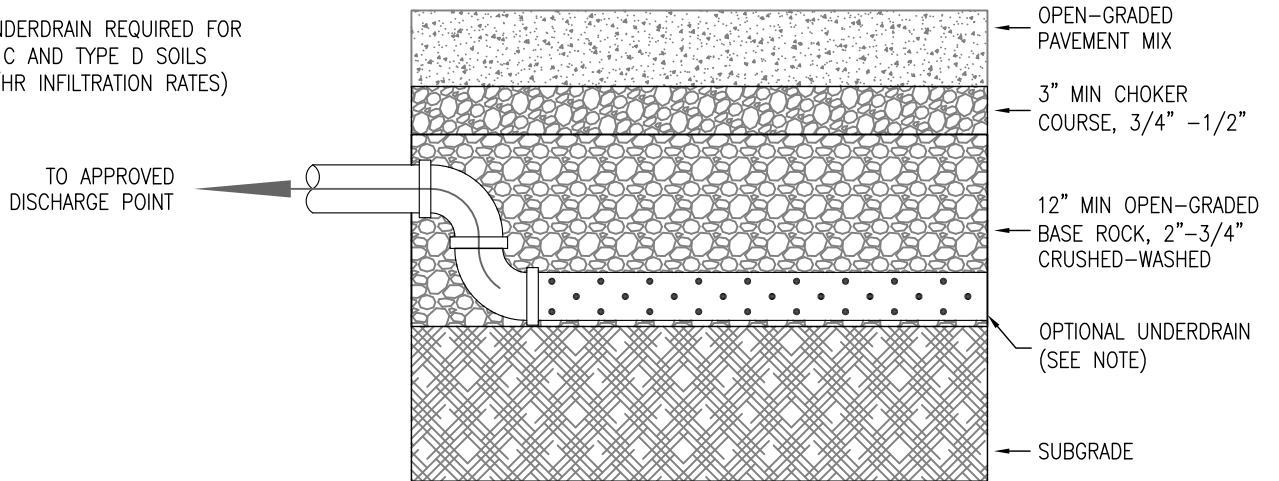

PERVIOUS (OPEN GRADED) CONCRETE AND ASPHALT SYSTEMS

- DRAWING NOT TO SCALE -

CITY OF GRESHAM	POROUS PAVEMENT	DRAWN RMS
		DATE APR 2018
		APPR.
		DWG. NO. ST-100